

# Ramp Handrail Height and Clearance (CA)


Building Code

Access

Egress

Construction Docs

Construction Phase

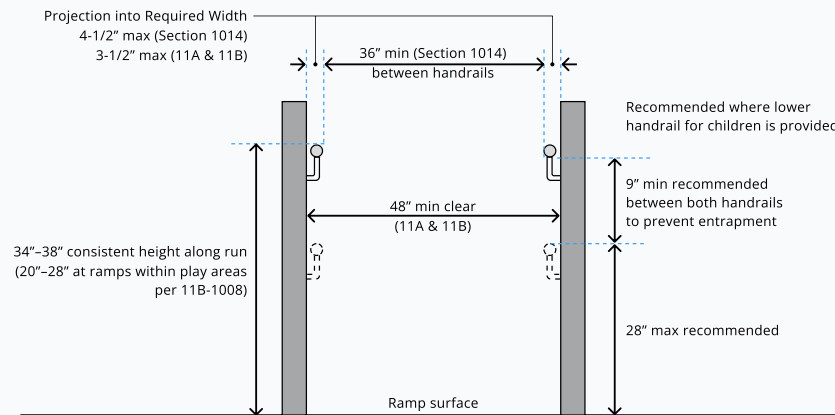

## Overview

Handrails are required on both sides of ramps with a rise greater than 6". According to Section 1014.8, the minimum width between handrails shall be 36 inches. Chapter 11A and 11B require ramps to provide a minimum clear width of 48 inches and allow the handrails to project into that required width by 3-1/2 inches maximum on each side.

## Primary Sections

CBC 1114A.1 Width ('22)    CBC 1122A.1 Width ('22)    CBC 11B-405.5 Clear Width ('22)

CBC 1014.8 Projections ('22)    CBC 1114A.1 Width ('22)    CBC 1122A.1 Width ('22)

CBC 11B-405.5 Clear Width ('22)    CBC 1014.8 Projections ('22)