

Surfaces and Thresholds at Doors

Fire Code

Accessibility Code

Life Safety Code

Building Code


Egress

Access

ADA

Construction Docs

Construction Phase

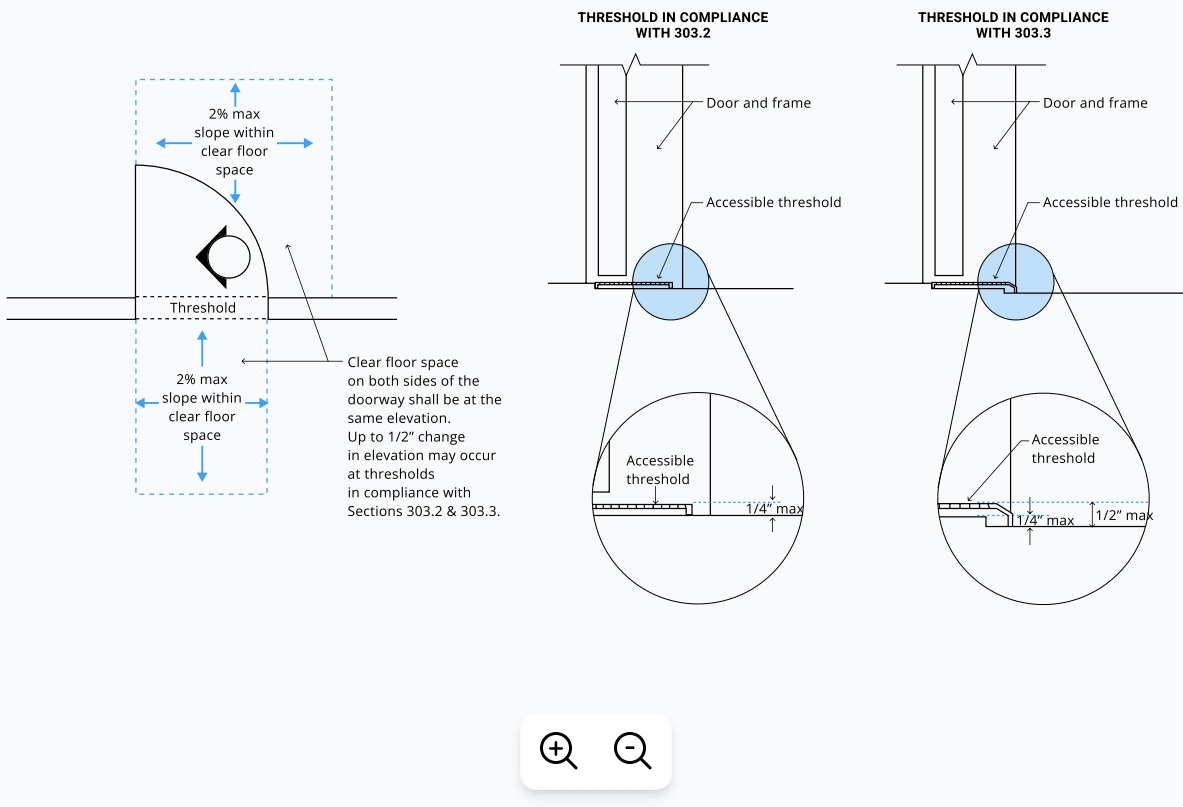

Overview

ADA Advisory: A change in level of $\frac{1}{2}$ inch is permitted to be $\frac{1}{4}$ inch vertical plus $\frac{1}{4}$ inch beveled. However, in no case may the combined change in level exceed $\frac{1}{2}$ inch. Changes in level exceeding $\frac{1}{2}$ inch must comply with Section 405 (Ramps) or Section 406 (Curb Ramps).

Primary Sections

CBC 1126A.2.1 Thresholds and Changes in Elevation ('22)

CBC 11B-404.2.5 Thresholds ('22)

CBC 11B-303.2 Vertical ('22)

CBC 11B-303.3 Beveled ('22)

CBC 11B-404.2.4.4 Floor or Ground Surface ('22)